

CLERMONT COUNTY, OHIO

Permit Center/Building Inspection Departments
 2275 Bauer Road Batavia, Ohio 45103

INSPECTIONS:

1. Electric trench & bonding before backfilling.
 2. Final electric inspection.
- Call 513-732-7213 the day before the inspection.

If you plan any lighting in or within 12' of the pool you will need to talk to the plans examiner. 513-732-7213

NEC 680.22 (B)

Pump conductor (wire) must reach the outlet without an extension cord. If plug in wire is used the maximum length is 3'.

NEC 680.8(A)


No outlets within 6' of the pool.

NEC 680.22 (A)(2)

Hard wired pump requires a switch within sight of the motor. Twist lock receptacle mounted on Weather Proof Box with cover on a 4" x 4" post must be between 6' to 10' of pool.

NEC 680.22 (A)(1) & 430.102 (B)(1)

CONTACT YOUR ZONING DEPARTMENT FOR FENCE REQUIREMENTS

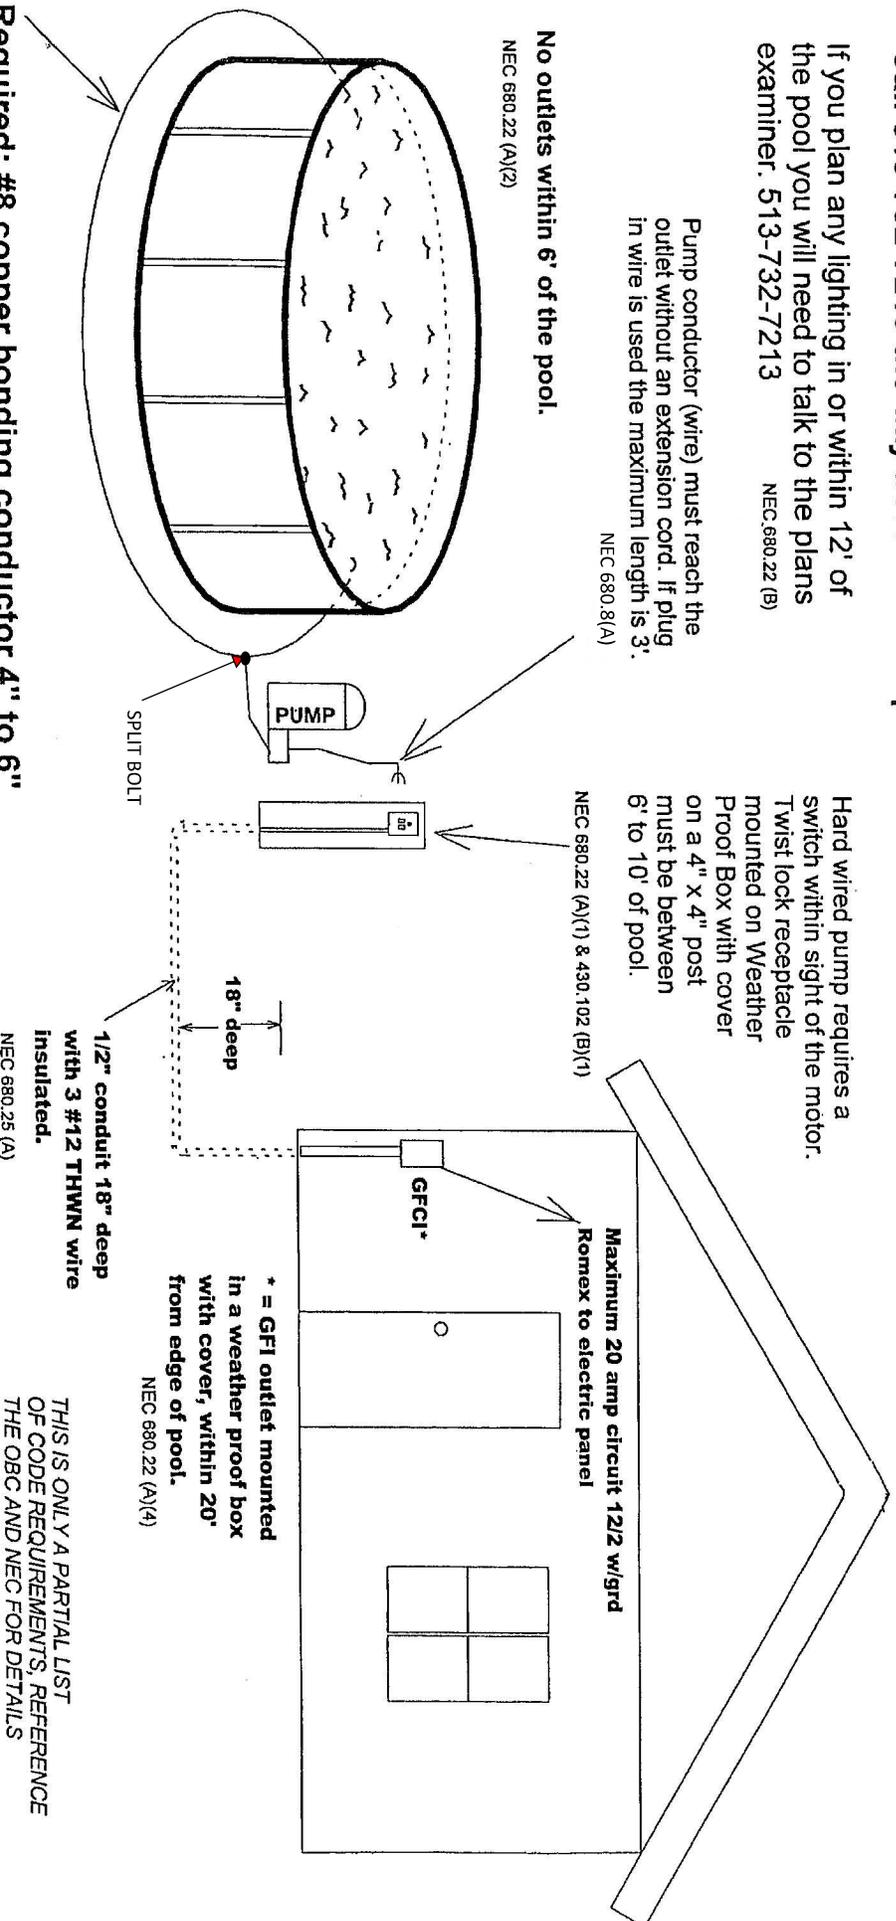

1/2" conduit 18" deep with 3 #12 THWN wire insulated. NEC 680.25 (A)

* = GFI outlet mounted in a weather proof box with cover, within 20' from edge of pool. NEC 680.22 (A)(4)

THIS IS ONLY A PARTIAL LIST OF CODE REQUIREMENTS, REFERENCE THE OBC AND NEC FOR DETAILS

Required; #8 copper bonding conductor 4" to 6" deep 18" to 24" from the pool edge to circle the entire pool and connected to the motor ground.

NEC 680.26 (B)(2)(4)